


Merrifield Estate - Stage 47, Mickleham

Level 1 Inspection & Testing Report

Reference: 1120 0304-1

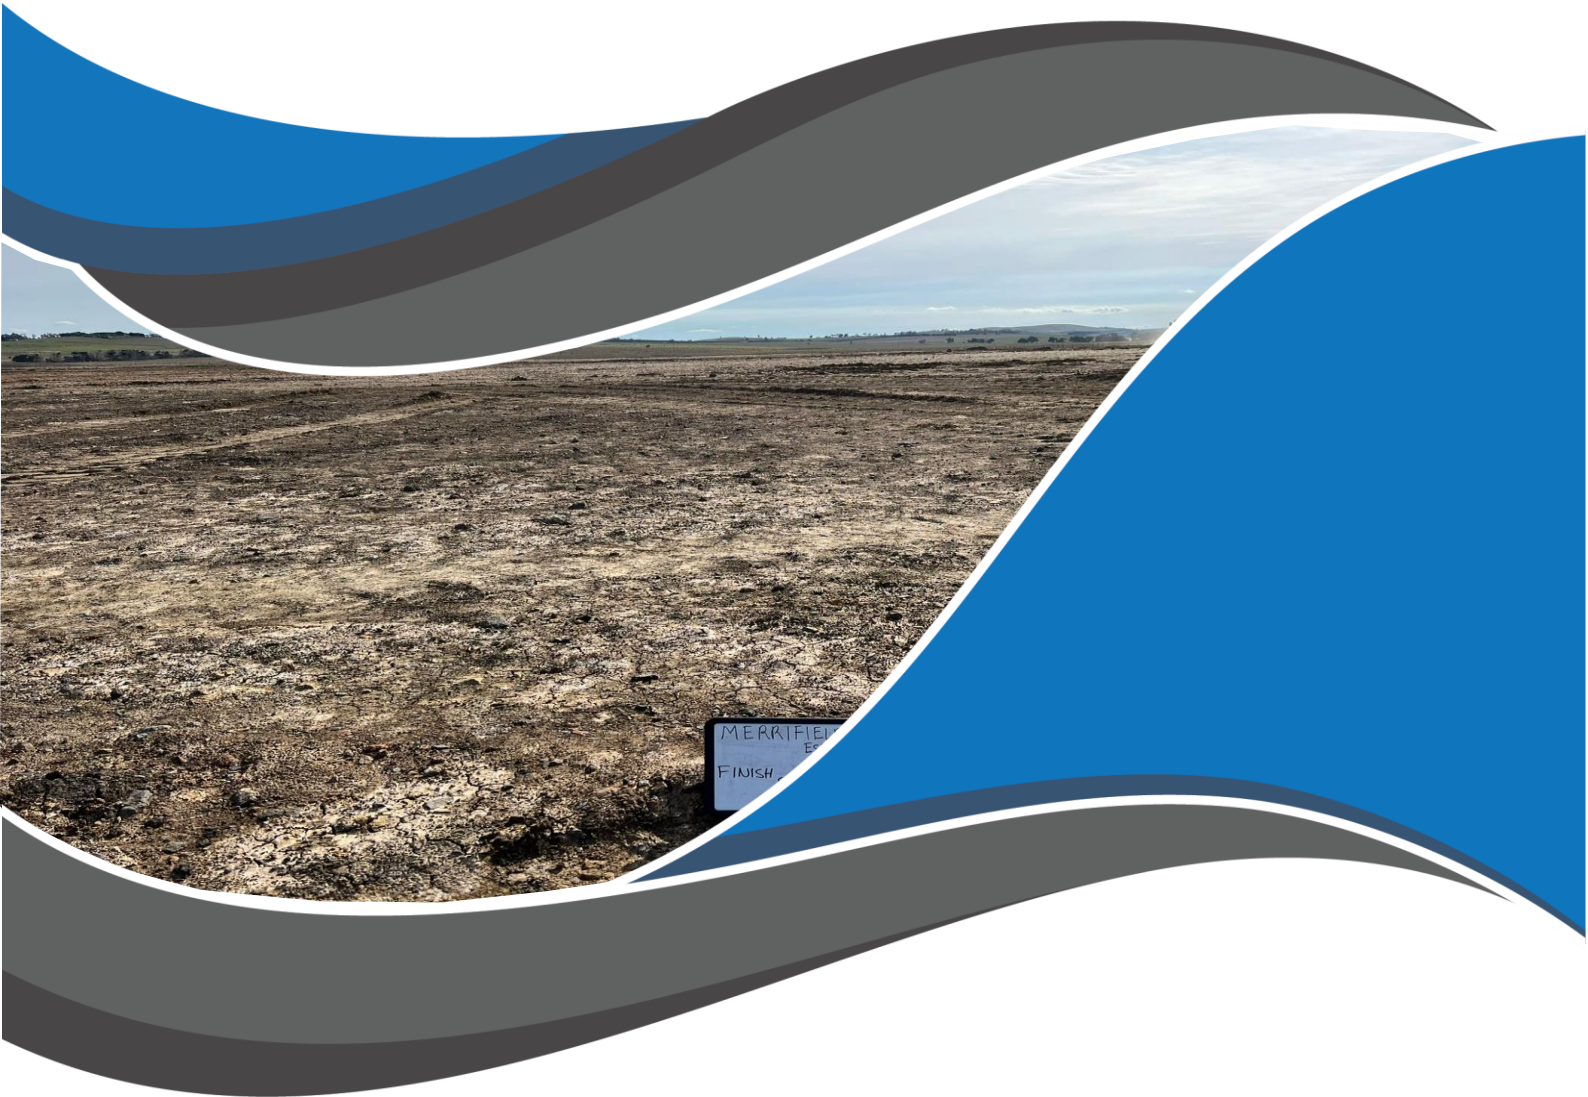

Prepared for:

BMD Urban

June 2022



A&Y ASSOCIATES
GEOTECHNICAL ENGINEERING CONSULTANTS

Document Control Record

Prepared by:

A&Y Associates Pty Ltd

ABN 92 614 244 665

5/16 Network Drive

Truganina, VIC 3029

T: (03) 8754 8325

E: info@ayassociates.com.au

W: www.ayassociates.com.au

Document control

Report title		Level 1 Inspection & Testing			
Project reference number		1120 0304-1			
Client		BMD Urban			
Contact name		Alyssa Willder			
Contact number		0400 207 600			
Contact e-mail		Alyssa.willder@bmd.com.au			
Revision	Date	Descriptions/Status	Author	Reviewer	Approver
0	27/04/2022	Final	B Mu	A Tan	A Tan
1	01/06/2022	Amendment	B Mu	A Tan	A Tan

Approver



Alvin Tan

(BE Civil and Infrastructure), MIEAust

Senior Geotechnical Engineer

E: alvin@ayassociates.com.au | M: 0449 288 338



ENGINEERS
AUSTRALIA
Professional Engineer
MEMBER

Disclaimer

The findings and conclusions contained in this report are made based on site conditions that existed at the time this work was conducted. The conclusions present in this report are relevant to the conditions of the site and the state of legislation currently enacted as at the date of this report.

Findings and conclusions are made assuming that the soil, groundwater, geological and chemical conditions detailed within this report are accurate and remain applicable to the site at the time of writing. No other warranties are made or intended.

A&Y Associates (A&Y) Pty Ltd has used a degree of skill and care ordinarily exercised by reputable members of our profession practicing in the same or similar locality.

A&Y does not make any representation or warranty that the conclusions in this report will be applicable in the future as there may be changes in the condition of the site, applicable legislation or other factors that would affect the conclusions contained in this report.

This report has been prepared exclusively for use by our client. This report cannot be reproduced without the written authorisation of A&Y and then can only be reproduced in its entirety.

Applicability

This report has been prepared for the benefit for our client with respect to the particular brief given to us and it may not be relied upon in other contexts or for any other purpose without our prior review and agreement.

No responsibility for this report will be taken by A&Y if it is altered in any way, or not reproduced in full.

Contents

1	Introduction.....	3
2	Project Summary	3
3	Project Specifications.....	4
4	Subgrade Assessment.....	5
5	Earthworks	5
6	Fill Material	5
7	Testing.....	6
8	Finished Surface Levels	6
9	Exclusion	6
10	Conclusion	7
	Appendix A - Site Plan	8
	Appendix B – Test Locations	11
	Appendix C – Test Results Summary	13
	Appendix D – NATA Test Results	20

1 Introduction

This report presents the results of the Level 1 Inspection and Testing for the construction of the fill platforms located in Merrifield Estate - Stage 47, Mickleham.

2 Project Summary

It is understood that BMD Urban required the fill platforms within Merrifield Estate - Stage 47, Mickleham to be constructed under Level 1 Inspection and Testing undertaken by a Geotechnical Inspection and Testing Authority (GITA).

Level 1 Inspection and Testing, as defined in AS3798-2007 "Guidelines on Earthworks for Commercial and Residential Development," provides for full time inspection of the construction of controlled fill and field and laboratory testing in accordance with AS1289 "Methods of Testing Soils for Engineering Purposes".

The Level 1 inspection was undertaken by a Geotechnician from A&Y Associates over a period of fifty-four (54) working days from **2nd September 2021 to 29th March 2022**.

This report is applicable for fill placed by BMD Urban in Merrifield Estate - Stage 47, Mickleham, as shown in Appendix A – Site Plan.

A heat map indicating the amount of cut and fill prepared by JAC Surveyors dated 10th March 2022 has been attached in Appendix A along with the site plan. It should be noted that the level 1 inspection and testing also cover some areas in the cut zone due to soft spot remediation and over-excavation during the removal of stockpiles placed on site.

3 Project Specifications

No specification has been provided for the construction works in Merrifield Estate - Stage 47, Mickleham. The supervision and inspections were performed based on AS3798. A short summary of the requirements outlined in AS3798 is provided below:

- Material to be used for fill construction shall satisfy the requirements of AS3798-2007 "Guidelines on Earthworks for Commercial and Residential Developments". The material used shall be free of:
 - All filling in excess of 300mm depth within the building envelope of allotments shall be undertaken to specifications satisfying the requirements of AS3798;
 - Organic soils, such as topsoils, severely root affected subsoil and peat;
 - Contaminated soils;
 - Materials which undergo volume change or loss of strength when disturbed and exposed to moisture;
 - Silts, or materials that have deleterious engineering properties of silt;
 - Fill that contains wood, metal, plastic, boulders, or other deleterious material, in sufficient proportions to affect the required performance of fill;
 - The maximum particle size of any rocks or other lump, within the layer, has not exceeded two-thirds (2/3) of the compacted layer thickness.
- Compaction to achieve a dry density ratio of at least 95% Standard, as the project was classified as **Residential**.

4 Subgrade Assessment

The subgrade was assessed by A&Y Associates following the topsoil removal and before any fill was placed. The subgrade assessment was undertaken over 5 working days from the **1st of September 2021 to 17th of January 2022** as mentioned in report *1120 0304-1-Rev1 (SSI1)*.

The exposed subgrade material comprised natural silty clay. No wet or soft patches were found during the inspection. No evidence of deleterious material was found during the inspection.

5 Earthworks

The earthworks for this project included stripping of topsoil, removing of tree roots, proof rolling the subgrade and placement and compaction of fill to construct engineered platforms.

Based on design plans and site inspection, it appears that the fill thickness placed is approximately 200mm-2000mm. The fill layers or thickness nominated in this report are provided as a guide on the amounts of fill placed and do not necessarily reflect an accurate survey of the fill levels.

6 Fill Material

The fill material used for the platform consisted of site derived material. The material was predominantly comprised of Silty Clay with gravel.

7 Testing

Field density testing was undertaken on the compacted fill at a frequency of a minimum of 3 tests per lot (AS3798 Table 8.1).

Tests were performed using a Nuclear Density Gauge for field density determination as per AS 1289.5.8.1. Testing was completed at a minimum rate of 3 field density tests per day's production based on the minimum requirements of AS 3798-2007 and taken from each layer of fill placed.

A total of 165 field density tests were performed during the earthworks. All of the test results met the specified compaction requirement of 95% Standard Compaction.

The locations of the 165 field density tests are shown in Appendix B – Test Locations. A summary of the test results obtained from the field density testing is presented in Appendix C – Test Results Summary. The laboratory test reports of the field density tests are presented in Appendix D – NATA Test Results.

8 Finished Surface Levels

It should be noted that even though the final fill layer meets the specification requirements, over time, the material may be subject to adverse weather conditions resulting in either surface softening or drying and cracking. The top 150mm – 200mm of the fill will deteriorate with time and should be considered by the foundation engineer.

9 Exclusion

A&Y Associates was not involved in monitoring and testing the following works and as such are not included in the Level 1 report.

- Any trenches excavated and backfilled on site for the installation of underground services such as sewers, electrical conduits, water mains etc.
- Footpaths in front of the lots that may be excavated and filled after the Level 1 supervision conducted by A&Y Associates.
- Uncontrolled fill and topsoil that may have been placed as part of the landscaping of the site following the completion of the engineered fill construction.


10 Conclusion


On the completion of the earthworks and after analysing the materials used, it has been concluded that the filling procedure conducted by BMD Urban appears to be consistent with the requirements of AS 3798 in regards to the placement of fill materials on a project under Level 1 Supervision and in accordance with the project specification as provided to A&Y Associates.

Appendix A - Site Plan




Area Inspected and Tested

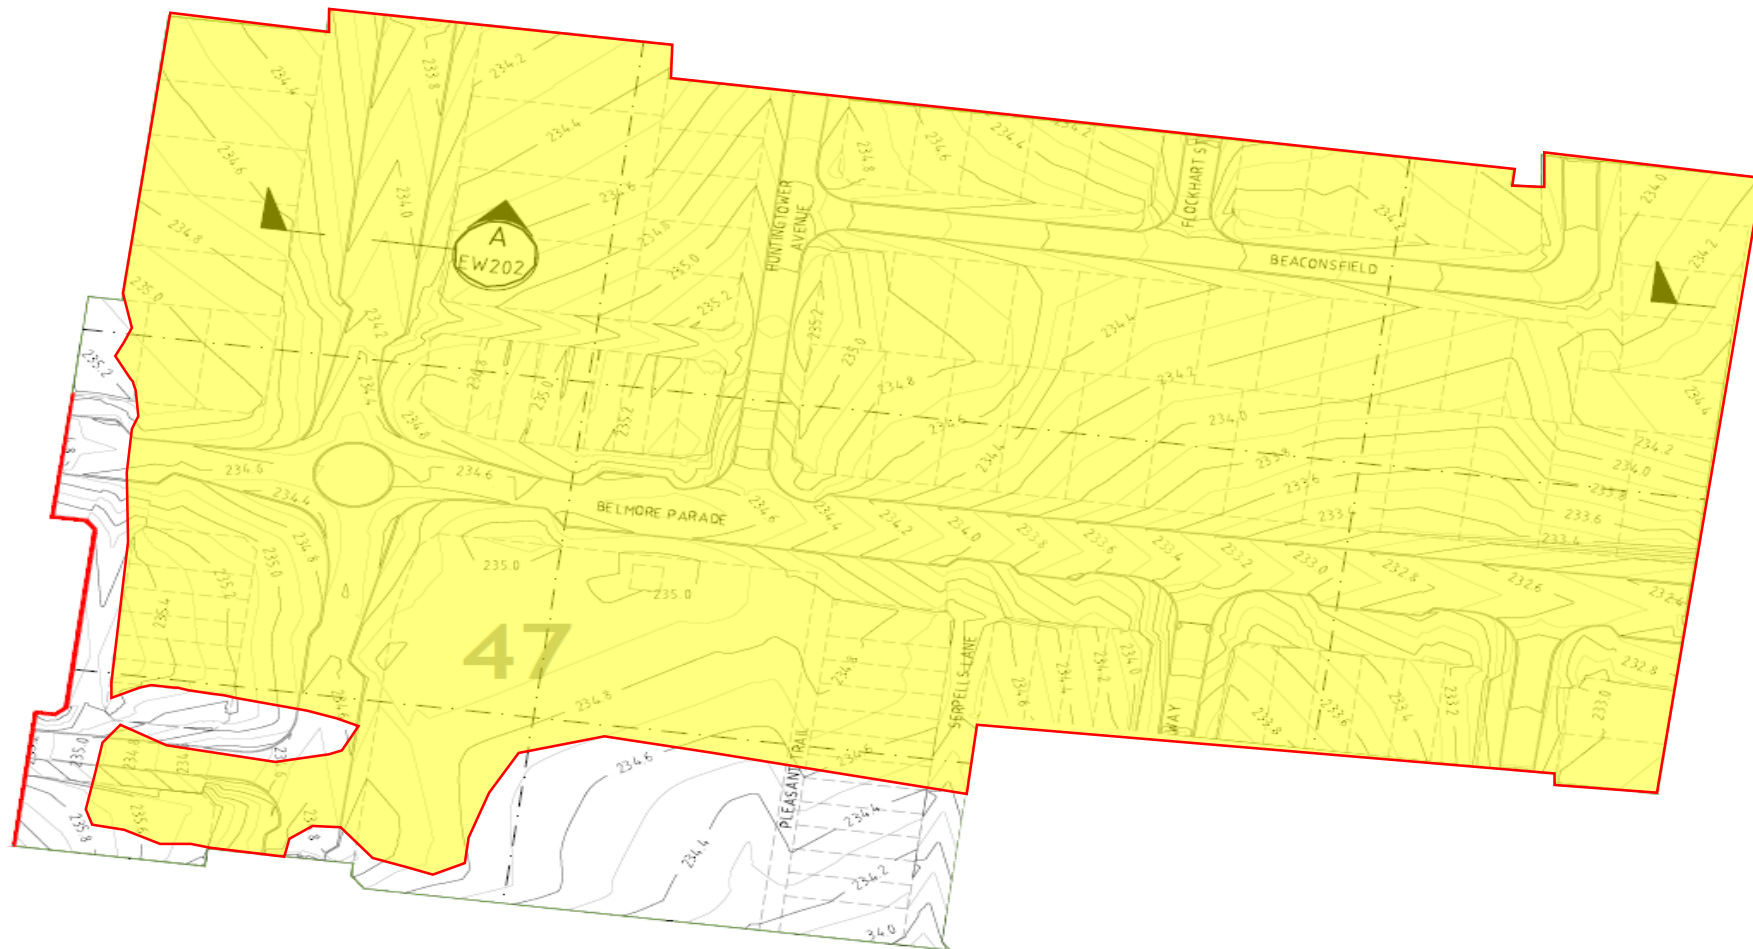

PROJECT: Merrifield Estate – Stage 47 (Level 1)	CLIENT: BMD Urban	SITE PLAN SKETCH—NOT TO SCALE	 A&Y ASSOCIATES GEOTECHNICAL ENGINEERING CONSULTANTS
LOCATION: Mickleham	PROJECT No: 1120 0304-1		

Merrifield St47 Heatmap

Volumes Required
Fill-84,670m3
Cut-8,860m3

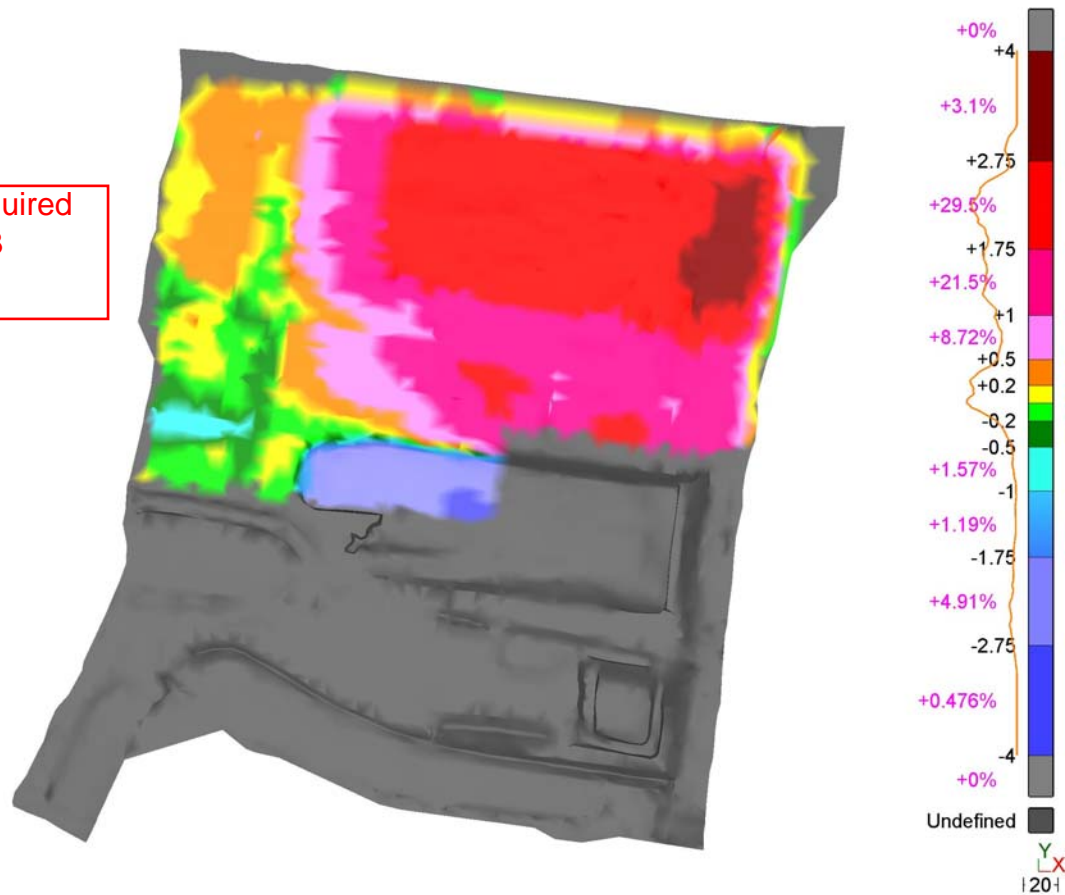


3DReshaper
www.3dreshaper.com
support@3dreshaper.com




Appendix B – Test Locations



Test Location

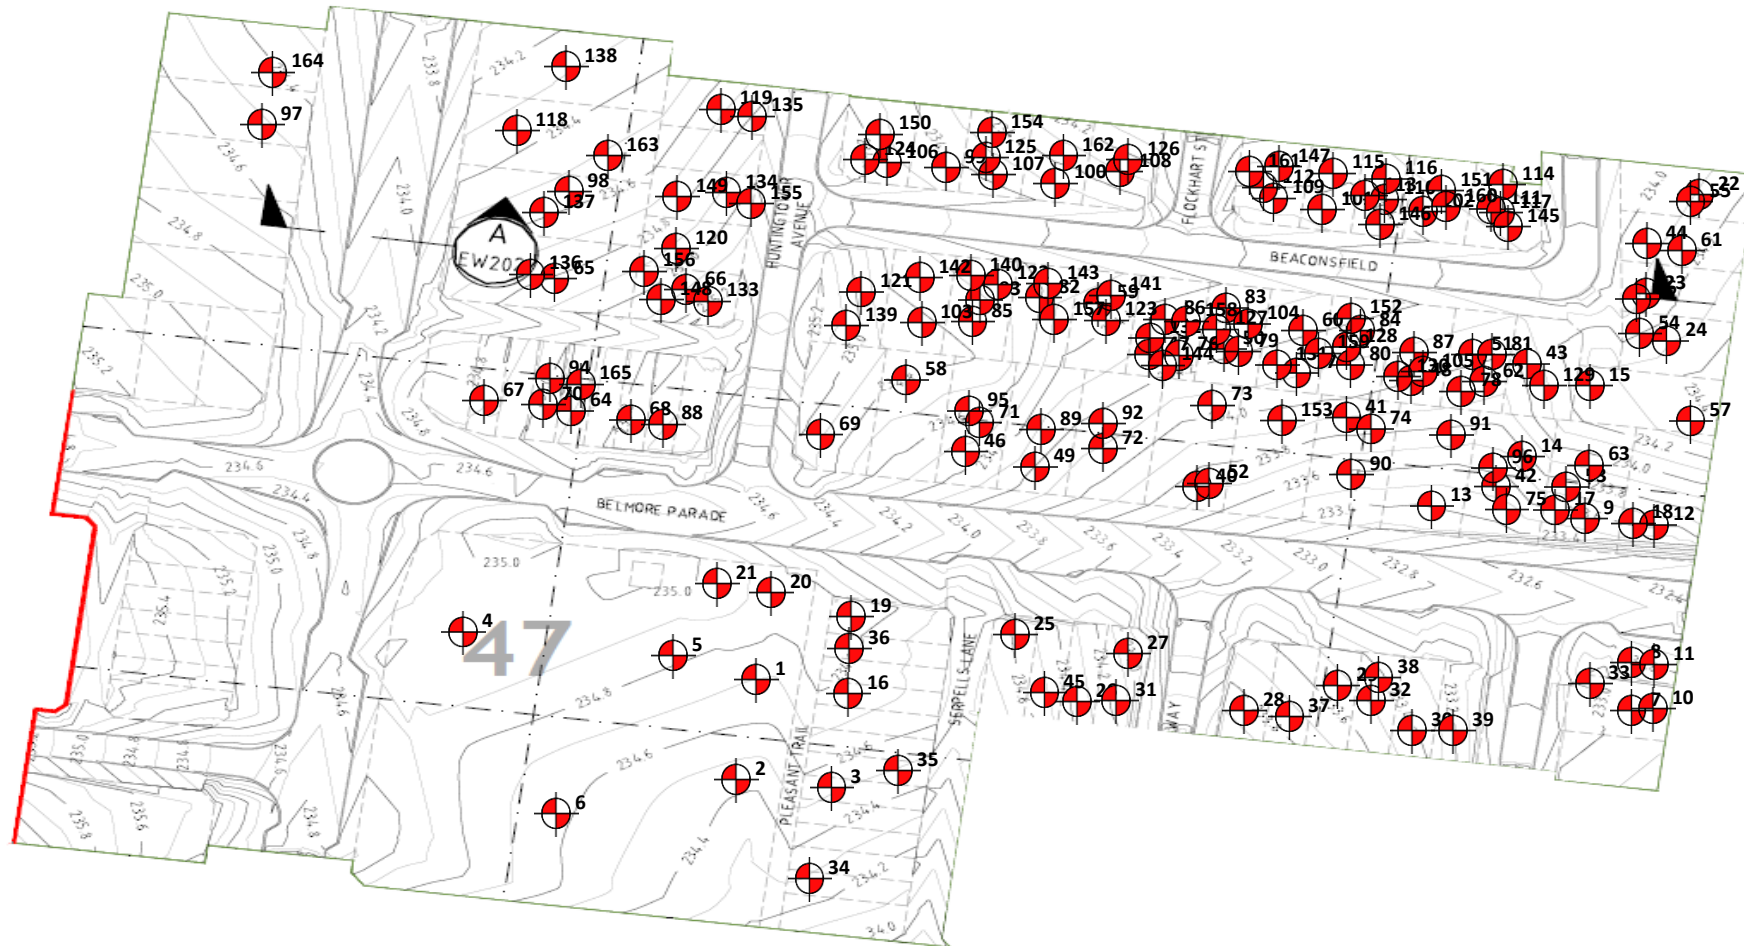

PROJECT: Merrifield Estate – Stage 47 (Level 1)	CLIENT: BMD Urban	SITE PLAN SKETCH—NOT TO SCALE	 A&Y ASSOCIATES GEOTECHNICAL ENGINEERING CONSULTANTS
LOCATION: Mickleham	PROJECT No: 1120 0304-1		

Appendix C – Test Results Summary

Project No		1120 0304-1			Client	BMD Urban				
Project Name		Merrifield Stage - Stage 47			Specification			Density Ratio ≥ 95% of Peak Wet Density		
Location		Mickleham								
Test No	Retest of Test	Date	Location	Layer	Oversize	Density Ratio	Moisture Ratio	Moisture Variation	Pass / Fail	Retest
#	#		Lot #	#	%	%	%	%		Pass / Fail
1	-	2/09/2021	-	1	6.0	95.0	106.0	1.0	Pass	-
2	-	2/09/2021	-	1	6.0	95.5	101.0	0.0	Pass	-
3	-	2/09/2021	-	1	7.4	96.0	101.5	0.0	Pass	-
4	-	3/09/2021	-	1	4.3	95.0	102.0	0.5	Pass	-
5	-	3/09/2021	-	1	4.9	95.0	99.5	0.0	Pass	-
6	-	3/09/2021	-	1	5.6	95.0	98.0	-0.5	Pass	-
7	-	3/09/2021	-	1	4.6	95.5	100.5	0.0	Pass	-
8	-	3/09/2021	-	1	5.7	95.0	104.0	1.0	Pass	-
9	-	3/09/2021	-	2	5.6	95.5	100.5	0.5	Pass	-
10	-	9/09/2021	-	3	15.6	96.5	100.0	0.0	Pass	-
11	-	9/09/2021	-	4	14.8	96.5	99.0	-0.5	Pass	-
12	-	9/09/2021	-	4	16.0	96.0	97.5	-0.5	Pass	-
13	-	10/09/2021	-	1	10.0	97.0	98.0	-0.5	Pass	-
14	-	10/09/2021	-	1	8.9	96.0	98.0	-0.5	Pass	-
15	-	10/09/2021	-	2	9.3	99.5	98.0	-0.5	Pass	-
16	-	11/09/2021	-	2	0.0	96.5	99.0	0.0	Pass	-
17	-	11/09/2021	-	2	0.0	95.5	98.0	-0.5	Pass	-
18	-	11/09/2021	-	2	0.0	96.0	102.0	0.0	Pass	-
19	-	14/09/2021	-	FSL	7.5	97.5	98.0	-0.5	Pass	-
20	-	14/09/2021	-	FSL	6.7	95.5	98.5	-0.5	Pass	-
21	-	14/09/2021	-	FSL	6.9	96.0	100.0	-0.5	Pass	-
22	-	15/09/2021	-	2	6.9	98.0	97.5	-0.5	Pass	-
23	-	15/09/2021	-	1	4.0	103.5	98.5	-0.5	Pass	-
24	-	15/09/2021	-	2	7.2	95.0	97.0	-0.5	Pass	-

25	-	16/09/2021	-	1	6.8	97.0	97.5	-0.5	Pass	-
26	-	16/09/2021	-	1	5.9	95.5	98.0	-0.5	Pass	-
27	-	16/09/2021	-	1	6.5	96.0	98.0	-0.5	Pass	-
28	-	17/09/2021	-	1	4.6	96.5	99.0	-0.5	Pass	-
29	-	17/09/2021	-	2	2.6	96.5	99.0	-0.5	Pass	-
30	-	17/09/2021	-	2	4.3	96.5	98.5	-0.5	Pass	-
31	-	18/09/2021	-	4	7.2	95.5	97.5	-0.5	Pass	-
32	-	18/09/2021	-	3	6.9	96.0	96.5	-0.5	Pass	-
33	-	18/09/2021	-	4	3.8	96.0	98.5	-0.5	Pass	-
34	-	8/10/2021	-	FSL	6.0	99.0	98.5	-0.5	Pass	-
35	-	8/10/2021	-	FSL	6.5	99.0	97.0	-0.5	Pass	-
36	-	8/10/2021	-	FSL	6.3	98.5	98.0	-0.5	Pass	-
37	-	11/10/2021	-	FSL	6.5	99.0	95.5	-0.5	Pass	-
38	-	11/10/2021	-	FSL	6.2	99.0	98.0	-0.5	Pass	-
39	-	11/10/2021	-	FSL	6.0	99.0	97.5	-0.5	Pass	-
40	-	12/10/2021	-	1	5.0	97.5	95.5	-0.5	Pass	-
41	-	12/10/2021	-	1	5.3	96.5	97.5	-0.5	Pass	-
42	-	12/10/2021	-	2	5.4	96.5	97.5	-0.5	Pass	-
43	-	13/10/2021	-	1	5.6	95.5	97.0	-1.0	Pass	-
44	-	13/10/2021	-	2	4.5	97.5	88.5	-3.0	Pass	-
45	-	13/10/2021	-	FSL	5.6	95.5	97.5	-0.5	Pass	-
46	-	21/10/2021	-	1	5.0	96.0	98.0	-0.5	Pass	-
47	-	21/10/2021	-	1	5.6	96.5	96.5	-0.5	Pass	-
48	-	21/10/2021	-	1	6.0	98.0	97.0	-0.5	Pass	-
49	-	22/10/2021	-	2	7.1	95.5	96.0	-0.5	Pass	-
50	-	22/10/2021	-	2	7.2	96.5	95.5	-1.0	Pass	-
51	-	22/10/2021	-	2	7.0	98.0	96.0	-1.0	Pass	-
52	-	25/10/2021	-	3	7.1	98.5	96.5	-0.5	Pass	-
53	-	25/10/2021	-	4	6.9	96.0	97.5	-0.5	Pass	-
54	-	25/10/2021	-	2	7.4	95.5	98.0	-0.5	Pass	-

55	-	29/11/2021	-	3	5.3	96.0	97.0	-0.5	Pass	-
56	-	29/11/2021	-	3	4.5	98.5	99.0	-0.5	Pass	-
57	-	29/11/2021	-	3	3.5	96.5	95.5	-0.5	Pass	-
58	-	30/11/2021	-	4	4.5	95.5	99.5	-0.5	Pass	-
59	-	30/11/2021	-	4	5.0	95.5	100.0	0.0	Pass	-
60	-	30/11/2021	-	4	5.0	96.0	96.0	-0.5	Pass	-
61	-	1/12/2021	-	4	0.0	98.0	100.0	0.0	Pass	-
62	-	1/12/2021	-	4	0.0	96.0	102.0	0.5	Pass	-
63	-	1/12/2021	-	5	0.0	97.0	101.0	0.0	Pass	-
64	-	3/12/2021	-	1	0.0	98.0	99.5	0.0	Pass	-
65	-	3/12/2021	-	1	0.0	98.0	101.0	0.0	Pass	-
66	-	3/12/2021	-	1	0.0	98.0	101.0	0.5	Pass	-
67	-	16/12/2021	-	1	7.0	97.0	97.5	-0.5	Pass	-
68	-	16/12/2021	-	1	6.0	97.0	98.0	-0.5	Pass	-
69	-	16/12/2021	-	1	4.5	98.0	98.0	-0.5	Pass	-
70	-	17/12/2021	-	2	5.0	95.5	95.5	-1.0	Pass	-
71	-	17/12/2021	-	2	7.0	95.5	98.5	-0.5	Pass	-
72	-	17/12/2021	-	2	4.5	95.5	97.0	-0.5	Pass	-
73	-	21/12/2021	-	1	7.0	96.0	98.5	0.0	Pass	-
74	-	21/12/2021	-	1	6.0	97.0	95.5	-0.5	Pass	-
75	-	21/12/2021	-	1	7.4	95.5	98.0	-0.5	Pass	-
76	-	4/01/2022	-	1	5.0	96.0	95.5	-1.0	Pass	-
77	-	4/01/2022	-	1	4.6	95.5	97.0	-0.5	Pass	-
78	-	4/01/2022	-	1	6.1	95.5	96.0	-0.5	Pass	-
79	-	5/01/2022	-	2	4.0	95.5	96.5	-0.5	Pass	-
80	-	5/01/2022	-	2	3.5	96.0	94.5	-1.0	Pass	-
81	-	5/01/2022	-	2	3.0	96.0	96.5	-0.5	Pass	-
82	-	6/01/2022	-	2	5.0	95.5	96.0	-0.5	Pass	-
83	-	6/01/2022	-	2	5.0	96.5	97.5	-0.5	Pass	-
84	-	6/01/2022	-	2	6.0	96.5	97.5	-0.5	Pass	-

85	-	7/01/2022	-	3	4.0	95.5	84.5	-3.0	Pass	-
86	-	7/01/2022	-	3	5.1	98.5	82.0	-3.0	Pass	-
87	-	7/01/2022	-	3	3.8	99.0	88.0	-2.5	Pass	-
88	-	8/01/2022	-	4	3.0	96.5	97.5	-0.5	Pass	-
89	-	8/01/2022	-	4	4.0	98.0	99.0	-0.5	Pass	-
90	-	8/01/2022	-	4	2.0	96.5	97.0	-0.5	Pass	-
91	-	10/01/2022	-	5	6.3	96.5	84.0	-2.5	Pass	-
92	-	10/01/2022	-	5	6.2	97.0	85.5	-2.5	Pass	-
93	-	10/01/2022	-	5	5.0	98.5	89.0	-3.0	Pass	-
94	-	11/01/2022	-	FSL	4.0	95.0	95.0	-0.5	Pass	-
95	-	11/01/2022	-	FSL	6.0	95.5	96.5	-0.5	Pass	-
96	-	11/01/2022	-	FSL	4.5	95.5	95.5	-1.0	Pass	-
97	-	18/01/2022	-	1	3.4	96.5	96.0	-0.5	Pass	-
98	-	18/01/2022	-	1	4.4	98.0	97.5	-0.5	Pass	-
99	-	18/01/2022	-	1	4.5	96.0	97.5	-0.5	Pass	-
100	-	19/01/2022	-	1	4.5	97.0	97.5	-0.5	Pass	-
101	-	19/01/2022	-	1	5.0	99.0	96.0	-0.5	Pass	-
102	-	19/01/2022	-	1	5.0	96.0	97.0	-0.5	Pass	-
103	-	20/01/2022	-	6	4.5	95.5	97.0	-0.5	Pass	-
104	-	20/01/2022	-	6	3.4	96.5	98.0	-0.5	Pass	-
105	-	20/01/2022	-	6	3.1	96.0	96.0	-0.5	Pass	-
106	-	3/02/2022	-	1	5.0	96.0	97.5	-0.5	Pass	-
107	-	3/02/2022	-	1	5.5	97.0	96.5	-0.5	Pass	-
108	-	3/02/2022	-	1	6.5	96.0	99.0	-0.5	Pass	-
109	-	15/02/2022	-	1	6.1	97.0	98.0	-0.5	Pass	-
110	-	15/02/2022	-	1	5.2	99.0	95.0	-0.5	Pass	-
111	-	15/02/2022	-	1	5.0	97.5	96.5	-0.5	Pass	-
112	-	18/02/2022	-	2	5.0	96.5	96.5	-0.5	Pass	-
113	-	18/02/2022	-	2	5.2	96.0	97.5	-0.5	Pass	-
114	-	18/02/2022	-	2	3.8	98.5	99.0	-0.5	Pass	-

115	-	21/02/2022	-	2	5.8	97.5	99.0	-0.5	Pass	-
116	-	21/02/2022	-	2	5.2	97.5	97.5	-0.5	Pass	-
117	-	21/02/2022	-	2	6.3	96.5	97.0	-0.5	Pass	-
118	-	25/02/2022	-	3	5.6	97.0	97.5	-0.5	Pass	-
119	-	25/02/2022	-	3	5.2	99.0	94.0	-1.0	Pass	-
120	-	25/02/2022	-	3	5.0	96.0	96.0	-0.5	Pass	-
121	-	26/02/2022	-	5	3.1	97.0	99.0	-0.5	Pass	-
122	-	26/02/2022	-	5	3.0	99.0	96.5	-0.5	Pass	-
123	-	26/02/2022	-	5	1.5	96.5	98.0	-0.5	Pass	-
124	-	28/02/2022	-	3	4.8	96.5	97.5	-0.5	Pass	-
125	-	28/02/2022	-	3	4.3	96.0	99.0	-0.5	Pass	-
126	-	28/02/2022	-	3	5.3	99.0	96.5	-0.5	Pass	-
127	-	15/03/2022	-	6	3.5	98.5	97.0	-1.0	Pass	-
128	-	15/03/2022	-	6	4.3	96.0	97.0	-1.0	Pass	-
129	-	15/03/2022	-	6	3.0	95.5	96.5	-1.0	Pass	-
130	-	16/03/2022	-	7	3.6	96.5	96.5	-1.0	Pass	-
131	-	16/03/2022	-	7	5.1	99.0	98.5	-0.5	Pass	-
132	-	16/03/2022	-	7	4.2	96.5	99.5	-0.5	Pass	-
133	-	17/03/2022	-	6	5.2	98.5	99.0	-0.5	Pass	-
134	-	17/03/2022	-	6	6.1	96.0	96.0	-0.5	Pass	-
135	-	17/03/2022	-	6	4.0	95.5	97.5	-0.5	Pass	-
136	-	18/03/2022	-	7	3.2	95.0	97.5	-0.5	Pass	-
137	-	18/03/2022	-	7	4.5	98.5	95.0	-0.5	Pass	-
138	-	18/03/2022	-	7	5.1	95.0	99.0	-0.5	Pass	-
139	-	19/03/2022	-	7	4.5	98.5	96.5	-0.5	Pass	-
140	-	19/03/2022	-	7	4.8	96.0	96.5	-0.5	Pass	-
141	-	19/03/2022	-	7	5.1	95.5	99.5	-0.5	Pass	-
142	-	21/03/2022	-	8	4.0	99.0	97.0	-0.5	Pass	-
143	-	21/03/2022	-	8	3.8	96.0	99.0	-0.5	Pass	-
144	-	21/03/2022	-	8	4.8	95.5	99.0	-0.5	Pass	-

145	-	22/03/2022	-	8	3.8	100.5	97.0	-0.5	Pass	-
146	-	22/03/2022	-	8	4.3	96.0	97.5	-0.5	Pass	-
147	-	22/03/2022	-	8	4.9	95.0	89.0	-2.0	Pass	-
148	-	23/03/2022	-	9	4.2	96.5	110.5	1.5	Pass	-
149	-	23/03/2022	-	9	5.2	97.0	95.0	-0.5	Pass	-
150	-	23/03/2022	-	9	4.0	95.5	97.5	-0.5	Pass	-
151	-	24/03/2022	-	9	3.2	98.0	97.5	-0.5	Pass	-
152	-	24/03/2022	-	9	5.8	95.5	99.0	0.0	Pass	-
153	-	24/03/2022	-	9	5.2	95.5	96.0	-0.5	Pass	-
154	-	25/03/2022	-	10	4.0	98.5	96.5	-0.5	Pass	-
155	-	25/03/2022	-	10	4.2	97.5	94.5	-1.0	Pass	-
156	-	25/03/2022	-	10	5.1	96.0	99.0	-0.5	Pass	-
157	-	26/03/2022	-	FSL	4.1	98.0	99.0	0.0	Pass	-
158	-	26/03/2022	-	FSL	4.5	95.5	97.5	-0.5	Pass	-
159	-	26/03/2022	-	FSL	4.9	96.0	96.0	-0.5	Pass	-
160	-	28/03/2022	-	FSL	5.2	96.0	99.0	-0.5	Pass	-
161	-	28/03/2022	-	FSL	5.8	96.5	97.5	-0.5	Pass	-
162	-	28/03/2022	-	FSL	3.8	96.0	97.0	-1.0	Pass	-
163	-	29/03/2022	-	FSL	4.3	98.0	97.0	-0.5	Pass	-
164	-	29/03/2022	-	FSL	4.0	95.5	97.5	-0.5	Pass	-
165	-	29/03/2022	-	FSL	5.1	95.5	93.5	-0.5	Pass	-

** Negative (-) value indicates that the field moisture content is drier than the optimum moisture content (OMC)

** Positive (+) value indicates that the field moisture content is wetter than the optimum moisture content (OMC)



Appendix D – NATA Test Results

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	1	
Location:	Mickleham					



Sample No	1	2	3			
Date Tested	2/09/2021	2/09/2021	2/09/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.93	t/m ³ 1.97	t/m ³ 1.99			
Field Moisture Content	% 24.3	% 24.2	% 24.3			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 6.0	WET, % 6.0	WET, % 7.4			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.01	t/m ³ 2.05	t/m ³ 2.06			
Optimum Moisture Content	% 23	% 24	% 24			

Moisture Ratio	% 106	% 101	% 101.5			
Moisture Variation	% 1.0	% 0.0	% 0.0			
from OMC	Wetter	OMC	OMC			
Density Ratio	% 95.0	% 95.5	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI01)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 6/09/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	2	
Location:	Mickleham					

Sample No	4	5	6			
Date Tested	3/09/2021	3/09/2021	3/09/2021			
Time Tested	AM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.80	t/m ³ 1.84	t/m ³ 1.85			
Field Moisture Content	% 25.5	% 30.8	% 25.9			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.3	WET, % 4.9	WET, % 5.6			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.89	t/m ³ 1.91	t/m ³ 1.94			
Optimum Moisture Content	% 25	% 31	% 26.5			

Moisture Ratio	% 102	% 99.5	% 98			
Moisture Variation	% 0.5	% 0.0	% -0.5			
from OMC	Wetter	OMC	Drier			
Density Ratio	% 95.0	% 95.0	% 95.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI02)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)



NATA Accredited Laboratory No. 20172
Accreditation for compliance with ISO/IEC 17025 - Testing
The results of tests, calibrations and/or measurements included
in this document, are traceable to Australian / National Standards

Approved Signatory:



David Burns

Date: 6/09/2021

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	3	
Location:	Mickleham					



Sample No	7	8	9			
Date Tested	3/09/2021	3/09/2021	3/09/2021			
Time Tested	AM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.93	t/m ³ 1.91	t/m ³ 1.94			
Field Moisture Content	% 27.2	% 27.6	% 26.7			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.6	WET, % 5.7	WET, % 5.6			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.01	t/m ³ 1.99	t/m ³ 2.02			
Optimum Moisture Content	% 27	% 26.5	% 26.5			

Moisture Ratio	% 100.5	% 104	% 100.5			
Moisture Variation	% 0.0	% 1.0	% 0.5			
from OMC	OMC	Wetter	Wetter			
Density Ratio	% 95.5	% 95.0	% 95.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI03)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 6/09/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	4	
Location:	Mickleham					



Sample No	10	11	12			
Date Tested	9/09/2021	9/09/2021	9/09/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 3	Layer 4	Layer 4			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.99	t/m ³ 2.00	t/m ³ 1.99			
Field Moisture Content	% 25.4	% 25.8	% 26.8			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, %	15.6	14.8	16.0		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.98	2.03	1.99		
Optimum Moisture Content	%	25.5	26	27.5		

Moisture Ratio	%	100	99	97.5		
Moisture Variation	%	0.0	-0.5	-0.5		
from OMC		OMC	Drier	Drier		
Density Ratio	%	96.5	96.5	96.0		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI04)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date:
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

David Burns
14/09/2021

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	5	
Location:	Mickleham					



Sample No	13	14	15			
Date Tested	10/09/2021	10/09/2021	10/09/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.99	t/m ³ 1.97	t/m ³ 1.99			
Field Moisture Content	% 22.5	% 26.4	% 22.5			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 10.0	WET, % 8.9	WET, % 9.3			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.04	t/m ³ 2.03	t/m ³ 2.01			
Optimum Moisture Content	% 23	% 27	% 23			

Moisture Ratio	% 98	% 98	% 98			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 97.0	% 96.0	% 99.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI05)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 14/09/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	6	
Location:	Mickleham					



Sample No	16	17	18			
Date Tested	11/09/2021	11/09/2021	11/09/2021			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 2	Layer 2	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.99	t/m ³ 1.97	t/m ³ 1.95			
Field Moisture Content	% 19.8	% 20.5	% 18.3			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 0.0	WET, % 0.0	WET, % 0.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.06	t/m ³ 2.06	t/m ³ 2.03			
Optimum Moisture Content	% 20	% 21	% 18			

Moisture Ratio	% 99	% 98	% 102			
Moisture Variation	% 0.0	% -0.5	% 0.0			
from OMC	OMC	Drier	OMC			
Density Ratio	% 96.5	% 95.5	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI06)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 14/09/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	7	
Location:	Mickleham					



Sample No	19	20	21			
Date Tested	14/09/2021	14/09/2021	14/09/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Final Layer	Final Layer	Final Layer			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.03	t/m ³ 1.97	t/m ³ 1.98			
Field Moisture Content	% 23.5	% 24.6	% 22.5			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 7.5	WET, % 6.7	WET, % 6.9			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.06	t/m ³ 2.05	t/m ³ 2.05			
Optimum Moisture Content	% 24	% 25	% 22.5			

Moisture Ratio	% 98	% 98.5	% 100			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 97.5	% 95.5	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI07)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 15/09/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	8	
Location:	Mickleham					



Sample No	22	23	24			
Date Tested	15/09/2021	15/09/2021	15/09/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 2	Layer 1	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.02	t/m ³ 1.99	t/m ³ 2.00			
Field Moisture Content	% 23.4	% 24.1	% 24.8			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 6.9	WET, % 4.0	WET, % 7.2			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.04	t/m ³ 1.91	t/m ³ 2.08			
Optimum Moisture Content	% 24	% 24.5	% 25.5			

Moisture Ratio	% 97.5	% 98.5	% 97			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 98.0	% 103.5	% 95.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI08)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 16/09/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	9	
Location:	Mickleham					



Sample No	25	26	27			
Date Tested	16/09/2021	16/09/2021	16/09/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.94	t/m ³ 1.93	t/m ³ 1.94			
Field Moisture Content	% 23.9	% 27.4	% 25.5			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 6.8	WET, % 5.9	WET, % 6.5			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.97	t/m ³ 2.00	t/m ³ 2.01			
Optimum Moisture Content	% 24.5	% 28	% 26			

Moisture Ratio	% 97.5	% 98	% 98			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 97.0	% 95.5	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI09)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 17/09/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	10	
Location:	Mickleham					



Sample No	28	29	30			
Date Tested	17/09/2021	17/09/2021	17/09/2021			
Time Tested	AM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 2	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.02	t/m ³ 1.90	t/m ³ 2.01			
Field Moisture Content	% 26.7	% 25.7	% 24.1			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.6	WET, % 2.6	WET, % 4.3			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.08	t/m ³ 1.96	t/m ³ 2.08			
Optimum Moisture Content	% 27	% 26	% 24.5			

Moisture Ratio	% 99	% 99	% 98.5			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 96.5	% 96.5	% 96.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI10)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/09/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	11	
Location:	Mickleham					



Sample No	31	32	33			
Date Tested	18/09/2021	18/09/2021	18/09/2021			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 4	Layer 3	Layer 4			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.00	t/m ³ 1.95	t/m ³ 1.85			
Field Moisture Content	% 21.9	% 21.3	% 25.6			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 7.2	WET, % 6.9	WET, % 3.8			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.08	t/m ³ 2.02	t/m ³ 1.91			
Optimum Moisture Content	% 22.5	% 22	% 26			

Moisture Ratio	% 97.5	% 96.5	% 98.5			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 95.5	% 96.0	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI11)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/09/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	12	
Location:	Mickleham					



Sample No	34	35	36			
Date Tested	8/10/2021	8/10/2021	8/10/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	FSL	FSL	FSL			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.89	t/m ³ 1.96	t/m ³ 1.93			
Field Moisture Content	% 24.2	% 22.8	% 21.6			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 6.0	WET, % 6.5	WET, % 6.3			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.89	t/m ³ 1.96	t/m ³ 1.93			
Optimum Moisture Content	% 24.5	% 23.5	% 22			

Moisture Ratio	% 98.5	% 97	% 98			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 99.0	% 99.0	% 98.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI12)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 12/10/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	13	
Location:	Mickleham					



Sample No	37	38	39			
Date Tested	11/10/2021	11/10/2021	11/10/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	FSL	FSL	FSL			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.02	t/m ³ 2.00	t/m ³ 1.98			
Field Moisture Content	% 20.1	% 22.6	% 23.0			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 6.5	WET, % 6.2	WET, % 6.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.02	t/m ³ 2.00	t/m ³ 1.98			
Optimum Moisture Content	% 21	% 23	% 23.5			

Moisture Ratio	% 95.5	% 98	% 97.5			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 99.0	% 99.0	% 99.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI13)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 12/10/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	14	
Location:	Mickleham					



Sample No	40	41	42			
Date Tested	12/10/2021	12/10/2021	12/10/2021			
Time Tested	AM	AM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.88	t/m ³ 1.89	t/m ³ 1.88			
Field Moisture Content	% 19.5	% 24.8	% 21.4			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, %	5.0	5.3	5.4		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.92	1.94	1.93		
Optimum Moisture Content	%	20.5	25.5	22		

Moisture Ratio	%	95.5	97.5	97.5		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	97.5	96.5	96.5		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI14)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 13/10/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	15	
Location:	Mickleham					



Sample No	43	44	45			
Date Tested	13/10/2021	13/10/2021	13/10/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 2	FSL			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.02	t/m ³ 1.97	t/m ³ 2.00			
Field Moisture Content	% 22.8	% 21.7	% 21.0			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 5.6	WET, % 4.5	WET, % 5.6			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.11	t/m ³ 2.01	t/m ³ 2.08			
Optimum Moisture Content	% 23.5	% 24.5	% 21.5			

Moisture Ratio	% 97	% 88.5	% 97.5			
Moisture Variation	% -1.0	% -3.0	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 95.5	% 97.5	% 95.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI15)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date:
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

David Burns
 14/10/2021

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	16	
Location:	Mickleham					



Sample No	46	47	48			
Date Tested	21/10/2021	21/10/2021	21/10/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.84	t/m ³ 1.82	t/m ³ 1.88			
Field Moisture Content	% 24.5	% 21.3	% 22.8			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, %	5.0	5.6	6.0		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.90	1.86	1.89		
Optimum Moisture Content	%	25	22	23.5		

Moisture Ratio	%	98	96.5	97		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	96.0	96.5	98.0		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI16)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 22/10/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	17	
Location:	Mickleham					



Sample No	49	50	51			
Date Tested	22/10/2021	22/10/2021	22/10/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 2	Layer 2	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.91	t/m ³ 1.95	t/m ³ 1.96			
Field Moisture Content	% 20.2	% 21.5	% 22.1			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 7.1	WET, % 7.2	WET, % 7.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.98	t/m ³ 2.00	t/m ³ 1.98			
Optimum Moisture Content	% 21	% 22.5	% 23			

Moisture Ratio	% 96	% 95.5	% 96			
Moisture Variation	% -0.5	% -1.0	% -1.0			
from OMC	Drier	Drier	Drier			
Density Ratio	% 95.5	% 96.5	% 98.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI17)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 25/10/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	18	
Location:	Mickleham					



Sample No	52	53	54			
Date Tested	25/10/2021	25/10/2021	25/10/2021			
Time Tested	AM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 3	Layer 4	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.97	t/m ³ 1.99	t/m ³ 1.94			
Field Moisture Content	% 23.6	% 23.4	% 23.5			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 7.1	WET, % 6.9	WET, % 7.4			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.97	t/m ³ 2.05	t/m ³ 2.01			
Optimum Moisture Content	% 24.5	% 24	% 24			

Moisture Ratio	% 96.5	% 97.5	% 98			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 98.5	% 96.0	% 95.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI18)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 26/10/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	19	
Location:	Mickleham					



Sample No	55	56	57			
Date Tested	29/11/2021	29/11/2021	29/11/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 3	Layer 3	Layer 3			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.13	t/m ³ 2.14	t/m ³ 2.11			
Field Moisture Content	% 14.6	% 13.9	% 14.8			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 5.3	WET, % 4.5	WET, % 3.5			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.21	t/m ³ 2.16	t/m ³ 2.18			
Optimum Moisture Content	% 15	% 14	% 15.5			

Moisture Ratio	% 97	% 99	% 95.5			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 96.0	% 98.5	% 96.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI19)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date:
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

David Burns
 3/12/2021

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	20	
Location:	Mickleham					



Sample No	58	59	60			
Date Tested	30/11/2021	30/11/2021	30/11/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 4	Layer 4	Layer 4			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.13	t/m ³ 2.11	t/m ³ 2.11			
Field Moisture Content	% 13.4	% 14.0	% 14.4			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.5	WET, % 5.0	WET, % 5.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.22	t/m ³ 2.21	t/m ³ 2.18			
Optimum Moisture Content	% 13.5	% 14	% 15			

Moisture Ratio	% 99.5	% 100	% 96			
Moisture Variation from OMC	% -0.5 Drier	% 0.0 OMC	% -0.5 Drier			
Density Ratio	% 95.5	% 95.5	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI20)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date:
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

David Burns
 3/12/2021

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	21	
Location:	Mickleham					



Sample No	61	62	63			
Date Tested	1/12/2021	1/12/2021	1/12/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 4	Layer 4	Layer 5			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.97	t/m ³ 1.94	t/m ³ 1.97			
Field Moisture Content	% 23.0	% 24.0	% 22.2			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 0.0	WET, % 0.0	WET, % 0.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.01	t/m ³ 2.02	t/m ³ 2.04			
Optimum Moisture Content	% 23	% 23.5	% 22			

Moisture Ratio	% 100	% 102	% 101			
Moisture Variation	% 0.0	% 0.5	% 0.0			
from OMC	OMC	Wetter	OMC			
Density Ratio	% 98.0	% 96.0	% 97.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI21)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 7/12/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	22	
Location:	Mickleham					

Sample No	64	65	66			
Date Tested	3/12/2021	3/12/2021	3/12/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.95	t/m ³ 1.98	t/m ³ 1.99			
Field Moisture Content	% 23.4	% 24.3	% 23.7			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 0.0	WET, % 0.0	WET, % 0.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.99	t/m ³ 2.02	t/m ³ 2.04			
Optimum Moisture Content	% 23.5	% 24	% 23.5			

Moisture Ratio	% 99.5	% 101	% 101			
Moisture Variation	% 0.0	% 0.0	% 0.5			
from OMC	OMC	OMC	Wetter			
Density Ratio	% 98.0	% 98.0	% 98.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI22)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)



NATA Accredited Laboratory No. 20172
Accreditation for compliance with ISO/IEC 17025 - Testing
The results of tests, calibrations and/or measurements included
in this document, are traceable to Australian / National Standards

Approved Signatory:



David Burns

Date: 7/12/2021

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	23	
Location:	Mickleham					



Sample No	67	68	69			
Date Tested	16/12/2021	16/12/2021	16/12/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.94	t/m ³ 1.89	t/m ³ 1.85			
Field Moisture Content	% 19.5	% 18.6	% 20.1			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 7.0	WET, % 6.0	WET, % 4.5			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.98	t/m ³ 1.92	t/m ³ 1.86			
Optimum Moisture Content	% 20	% 19	% 20.5			

Moisture Ratio	% 97.5	% 98	% 98			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 97.0	% 97.0	% 98.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI23)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 22/12/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	24	
Location:	Mickleham					



Sample No	70	71	72			
Date Tested	17/12/2021	17/12/2021	17/12/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 2	Layer 2	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.80	t/m ³ 1.89	t/m ³ 1.82			
Field Moisture Content	% 20.5	% 19.7	% 21.3			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 5.0	WET, % 7.0	WET, % 4.5			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.88	t/m ³ 1.96	t/m ³ 1.89			
Optimum Moisture Content	% 21.5	% 20	% 22			

Moisture Ratio	% 95.5	% 98.5	% 97			
Moisture Variation	% -1.0	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 95.5	% 95.5	% 95.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI24)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 22/12/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	25	
Location:	Mickleham					



Sample No	73	74	75			
Date Tested	21/12/2021	21/12/2021	21/12/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.05	t/m ³ 1.90	t/m ³ 2.01			
Field Moisture Content	% 14.3	% 14.8	% 15.2			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 7.0	WET, % 6.0	WET, % 7.4			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.12	t/m ³ 1.94	t/m ³ 2.09			
Optimum Moisture Content	% 14.5	% 15.5	% 15.5			

Moisture Ratio	% 98.5	% 95.5	% 98			
Moisture Variation	% 0.0	% -0.5	% -0.5			
from OMC	OMC	Drier	Drier			
Density Ratio	% 96.0	% 97.0	% 95.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI25)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 22/12/2021
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	26	
Location:	Mickleham					



Sample No	76	77	78			
Date Tested	4/01/2022	4/01/2022	4/01/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.83	t/m ³ 1.80	t/m ³ 1.80			
Field Moisture Content	% 17.2	% 16.5	% 14.4			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 5.0	WET, % 4.6	WET, % 6.1			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.89	t/m ³ 1.87	t/m ³ 1.87			
Optimum Moisture Content	% 18	% 17	% 15			

Moisture Ratio	% 95.5	% 97	% 96			
Moisture Variation	% -1.0	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 96.0	% 95.5	% 95.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI26)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 10/01/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	27	
Location:	Mickleham					



Sample No	79	80	81			
Date Tested	5/01/2022	5/01/2022	5/01/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 2	Layer 2	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.81	t/m ³ 1.85	t/m ³ 1.84			
Field Moisture Content	% 17.8	% 16.5	% 15.4			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.0	WET, % 3.5	WET, % 3.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.88	t/m ³ 1.91	t/m ³ 1.90			
Optimum Moisture Content	% 18.5	% 17.5	% 16			

Moisture Ratio	% 96.5	% 94.5	% 96.5			
Moisture Variation	% -0.5	% -1.0	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 95.5	% 96.0	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI27)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 10/01/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	28	
Location:	Mickleham					

Sample No	82	83	84			
Date Tested	6/01/2022	6/01/2022	6/01/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 2	Layer 2	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.82	t/m ³ 1.91	t/m ³ 1.98			
Field Moisture Content	% 19.7	% 14.6	% 15.6			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, %	5.0	5.0	6.0		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.89	1.96	2.04		
Optimum Moisture Content	%	20.5	15	16		

Moisture Ratio	%	96	97.5	97.5		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	95.5	96.5	96.5		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI28)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)



NATA Accredited Laboratory No. 20172
Accreditation for compliance with ISO/IEC 17025 - Testing
The results of tests, calibrations and/or measurements included
in this document, are traceable to Australian / National Standards

Approved Signatory:



David Burns
Date: 10/01/2022

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	29	
Location:	Mickleham					



Sample No	85	86	87			
Date Tested	7/01/2022	7/01/2022	7/01/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 3	Layer 3	Layer 3			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.87	t/m ³ 1.91	t/m ³ 2.01			
Field Moisture Content	% 14.8	% 13.1	% 18.9			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.0	WET, % 5.1	WET, % 3.8			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.95	t/m ³ 1.92	t/m ³ 2.02			
Optimum Moisture Content	% 17.5	% 16	% 21.5			

Moisture Ratio	% 84.5	% 82	% 88			
Moisture Variation from OMC	% -3.0 Drier	% -3.0 Drier	% -2.5 Drier			
Density Ratio	% 95.5	% 98.5	% 99.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI29)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 28/01/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	30	
Location:	Mickleham					



Sample No	88	89	90			
Date Tested	8/01/2022	8/01/2022	8/01/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 4	Layer 4	Layer 4			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.90	t/m ³ 1.86	t/m ³ 1.92			
Field Moisture Content	% 19.5	% 15.3	% 17.5			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, %	3.0	4.0	2.0		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.96	1.88	1.99		
Optimum Moisture Content	%	20	15.5	18		

Moisture Ratio	%	97.5	99	97		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	96.5	98.0	96.5		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI30)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 28/01/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	31	
Location:	Mickleham					

Sample No	91	92	93			
Date Tested	10/01/2022	10/01/2022	10/01/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 5	Layer 5	Layer 5			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.99	t/m ³ 1.90	t/m ³ 1.91			
Field Moisture Content	% 14.3	% 15.8	% 25.4			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 6.3	WET, % 6.2	WET, % 5.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.05	t/m ³ 1.95	t/m ³ 1.93			
Optimum Moisture Content	% 17	% 18.5	% 28.5			

Moisture Ratio	% 84	% 85.5	% 89			
Moisture Variation	% -2.5	% -2.5	% -3.0			
from OMC	Drier	Drier	Drier			
Density Ratio	% 96.5	% 97.0	% 98.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI31)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)



NATA Accredited Laboratory No. 20172
Accreditation for compliance with ISO/IEC 17025 - Testing
The results of tests, calibrations and/or measurements included
in this document, are traceable to Australian / National Standards

Approved Signatory:



David Burns
28/01/2022

Date:

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	32	
Location:	Mickleham					



Sample No	94	95	96			
Date Tested	11/01/2022	11/01/2022	11/01/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	FSL	FSL	FSL			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.80	t/m ³ 1.86	t/m ³ 1.80			
Field Moisture Content	% 19.5	% 18.3	% 17.7			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.0	WET, % 6.0	WET, % 4.5			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.88	t/m ³ 1.93	t/m ³ 1.87			
Optimum Moisture Content	% 20.5	% 19	% 18.5			

Moisture Ratio	% 95	% 96.5	% 95.5			
Moisture Variation	% -0.5	% -0.5	% -1.0			
from OMC	Drier	Drier	Drier			
Density Ratio	% 95.0	% 95.5	% 95.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI32)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 28/01/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	33	
Location:	Mickleham					



Sample No	97	98	99			
Date Tested	18/01/2022	18/01/2022	18/01/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.89	t/m ³ 1.88	t/m ³ 1.91			
Field Moisture Content	% 21.1	% 21.5	% 21.9			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, %	3.4	4.4	4.5		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.95	1.90	1.98		
Optimum Moisture Content	%	22	22	22.5		

Moisture Ratio	%	96	97.5	97.5		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	96.5	98.0	96.0		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI33)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 31/01/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	34	
Location:	Mickleham					



Sample No	100	101	102			
Date Tested	19/01/2022	19/01/2022	19/01/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.90	t/m ³ 1.89	t/m ³ 1.88			
Field Moisture Content	% 20.9	% 22.1	% 21.3			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.5	WET, % 5.0	WET, % 5.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.94	t/m ³ 1.89	t/m ³ 1.94			
Optimum Moisture Content	% 21.5	% 23	% 22			

Moisture Ratio	% 97.5	% 96	% 97			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 97.0	% 99.0	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI34)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 31/01/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022		
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	35		
Location:	Mickleham						



Sample No	103	104	105			
Date Tested	20/01/2022	20/01/2022	20/01/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 6	Layer 6	Layer 6			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.87	t/m ³ 1.88	t/m ³ 1.92			
Field Moisture Content	% 22.8	% 22.5	% 21.1			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.5	WET, % 3.4	WET, % 3.1			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.95	t/m ³ 1.93	t/m ³ 1.99			
Optimum Moisture Content	% 23.5	% 23	% 22			

Moisture Ratio	% 97	% 98	% 96			
Moisture Variation	% -0.5	% -0.5	% -1.0			
from OMC	Drier	Drier	Drier			
Density Ratio	% 95.5	% 96.5	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI35)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 31/01/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	36	
Location:	Mickleham					



Sample No	106	107	108			
Date Tested	03/02/2022	03/02/2022	03/02/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.97	t/m ³ 1.94	t/m ³ 2.00			
Field Moisture Content	% 17.5	% 17.9	% 16.3			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, %	5.0	5.5	6.5		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	2.05	1.99	2.06		
Optimum Moisture Content	%	18	18.5	16.5		

Moisture Ratio	%	97.5	96.5	99		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	96.0	97.0	96.0		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI36)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 18/02/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	37	
Location:	Mickleham					
Sample No	109	110	111			
Date Tested	15/02/2022	15/02/2022	15/02/2022			
Time Tested	AM	AM	AM			
Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 1	Layer 1	Layer 1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.01	t/m ³ 1.98	t/m ³ 1.93			
Field Moisture Content	% 17.6	% 18.5	% 16.9			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			
Oversize Material	WET, % 6.1	WET, % 5.2	WET, % 5.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.05	t/m ³ 1.99	t/m ³ 1.97			
Optimum Moisture Content	% 18	% 19.5	% 17.5			
Moisture Ratio	% 98	% 95	% 96.5			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 97.0	% 99.0	% 97.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI37)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)



NATA Accredited Laboratory No. 20172
Accreditation for compliance with ISO/IEC 17025 - Testing
The results of tests, calibrations and/or measurements included
in this document, are traceable to Australian / National Standards

Approved Signatory:



David Burns
Date: 18/02/2022

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	38	
Location:	Mickleham					

Sample No	112	113	114			
Date Tested	18/02/2022	18/02/2022	18/02/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 2	Layer 2	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.90	t/m ³ 1.91	t/m ³ 1.88			
Field Moisture Content	% 18.3	% 20.5	% 19.8			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 5.0	WET, % 5.2	WET, % 3.8			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.96	t/m ³ 1.98	t/m ³ 1.90			
Optimum Moisture Content	% 19	% 21	% 20			

Moisture Ratio	% 96.5	% 97.5	% 99			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 96.5	% 96.0	% 98.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI38)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)



NATA Accredited Laboratory No. 20172
Accreditation for compliance with ISO/IEC 17025 - Testing
The results of tests, calibrations and/or measurements included
in this document, are traceable to Australian / National Standards

Approved Signatory:



David Burns
23/02/2022

Date:

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	39	
Location:	Mickleham					



Sample No	115	116	117			
Date Tested	21/02/2022	21/02/2022	21/02/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 2	Layer 2	Layer 2			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.98	t/m ³ 1.95	t/m ³ 1.88			
Field Moisture Content	% 19.3	% 18.5	% 18.9			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 5.8	WET, % 5.2	WET, % 6.3			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.01	t/m ³ 1.98	t/m ³ 1.93			
Optimum Moisture Content	% 19.5	% 19	% 19.5			

Moisture Ratio	% 99	% 97.5	% 97			
Moisture Variation from OMC	% -0.5 Drier	% -0.5 Drier	% -0.5 Drier			
Density Ratio	% 97.5	% 97.5	% 96.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI39)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 23/02/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	40	
Location:	Mickleham					



Sample No	118	119	120			
Date Tested	25/02/2022	25/02/2022	25/02/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	3rd Layer	3rd Layer	3rd Layer			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.98	t/m ³ 1.94	t/m ³ 1.89			
Field Moisture Content	% 18.5	% 17.4	% 19.7			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, %	5.6	5.2	5.0		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	2.03	1.94	1.95		
Optimum Moisture Content	%	19	18.5	20.5		

Moisture Ratio	%	97.5	94	96		
Moisture Variation	%	-0.5	-1.0	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	97.0	99.0	96.0		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI40)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 28/02/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	41	
Location:	Mickleham					



Sample No	121	122	123			
Date Tested	26/02/2022	26/02/2022	26/02/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	5th Layer	5th Layer	5th Layer			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.84	t/m ³ 1.83	t/m ³ 1.81			
Field Moisture Content	% 24.7	% 25.1	% 24.0			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 3.1	WET, % 3.0	WET, % 1.5			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.89	t/m ³ 1.83	t/m ³ 1.87			
Optimum Moisture Content	% 25	% 26	% 24.5			

Moisture Ratio	% 99	% 96.5	% 98			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 97.0	% 99.0	% 96.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI41)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 01/03/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	42	
Location:	Mickleham					



Sample No	124	125	126			
Date Tested	28/02/2022	28/02/2022	28/02/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	3rd Layer	3rd Layer	3rd Layer			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.97	t/m ³ 1.90	t/m ³ 1.99			
Field Moisture Content	% 19.5	% 17.8	% 18.3			
Material:	Site Derived Clay Fill	Site Derived Clay Fill	Site Derived Clay Fill			

Oversize Material	WET, % 4.8	WET, % 4.3	WET, % 5.3			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.03	t/m ³ 1.97	t/m ³ 1.99			
Optimum Moisture Content	% 20	% 18	% 19			

Moisture Ratio	% 97.5	% 99	% 96.5			
Moisture Variation from OMC	% -0.5 Drier	% -0.5 Drier	% -0.5 Drier			
Density Ratio	% 96.5	% 96.0	% 99.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI42)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 <p>NATA WORLD RECOGNISED ACCREDITATION</p>	<p>NATA Accredited Laboratory No. 20172</p> <p>Accreditation for compliance with ISO/IEC 17025 - Testing</p> <p>The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards</p>	<p>Approved Signatory:</p>  <p>David Burns</p> <p>Date: 01/03/2022</p>
---	--	---

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	43	
Location:	Mickleham					



Sample No	127	128	129			
Date Tested	15/03/2022	15/03/2022	15/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 6	Layer 6	Layer 6			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.94	t/m ³ 1.91	t/m ³ 1.93			
Field Moisture Content	% 23.3	% 23.7	% 24.1			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, %	3.5	4.3	3.0		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.96	1.98	2.01		
Optimum Moisture Content	%	24	24.5	25		

Moisture Ratio	%	97	97	96.5		
Moisture Variation	%	-1.0	-1.0	-1.0		
from OMC		Drier	Drier	Drier		
Density Ratio	%	98.5	96.0	95.5		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI43)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/04/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	44	
Location:	Mickleham					



Sample No	130	131	132			
Date Tested	16/03/2022	16/03/2022	16/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 7	Layer 7	Layer 7			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.92	t/m ³ 1.97	t/m ³ 1.95			
Field Moisture Content	% 23.1	% 24.1	% 22.9			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, %	3.6	5.1	4.2		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.98	1.97	2.01		
Optimum Moisture Content	%	24	24.5	23		

Moisture Ratio	%	96.5	98.5	99.5		
Moisture Variation	%	-1.0	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	96.5	99.0	96.5		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI44)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date: 20/04/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	45	
Location:	Mickleham					



Sample No	133	134	135			
Date Tested	17/03/2022	17/03/2022	17/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 6	Layer 6	Layer 6			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 2.00	t/m ³ 2.01	t/m ³ 1.89			
Field Moisture Content	% 20.8	% 17.3	% 21.4			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, %	5.2	6.1	4.0		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	2.01	2.08	1.97		
Optimum Moisture Content	%	21	18	22		

Moisture Ratio	%	99	96	97.5		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	98.5	96.0	95.5		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI45)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date:
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

David Burns
20/04/2022

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	46	
Location:	Mickleham					



Sample No	136	137	138			
Date Tested	18/03/2022	18/03/2022	18/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 7	Layer 7	Layer 7			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.87	t/m ³ 1.95	t/m ³ 1.98			
Field Moisture Content	% 22.4	% 20.0	% 19.3			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, %	3.2	4.5	5.1		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.96	1.96	2.07		
Optimum Moisture Content	%	23	21	19.5		

Moisture Ratio	%	97.5	95	99		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	95.0	98.5	95.0		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI46)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/04/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	47	
Location:	Mickleham					



Sample No	139	140	141			
Date Tested	19/03/2022	19/03/2022	19/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 7	Layer 7	Layer 7			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.94	t/m ³ 1.89	t/m ³ 1.99			
Field Moisture Content	% 20.3	% 23.2	% 22.4			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, %	4.5	4.8	5.1		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.95	1.96	2.07		
Optimum Moisture Content	%	21	24	22.5		

Moisture Ratio	%	96.5	96.5	99.5		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	98.5	96.0	95.5		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI47)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  Date:
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	48	
Location:	Mickleham					



Sample No	142	143	144			
Date Tested	21/03/2022	21/03/2022	21/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 8	Layer 8	Layer 8			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.98	t/m ³ 1.94	t/m ³ 1.93			
Field Moisture Content	% 17.9	% 18.3	% 18.8			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, %	4.0	3.8	4.8		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	2.00	2.01	2.00		
Optimum Moisture Content	%	18.5	18.5	19		

Moisture Ratio	%	97	99	99		
Moisture Variation	%	-0.5	-0.5	-0.5		
from OMC		Drier	Drier	Drier		
Density Ratio	%	99.0	96.0	95.5		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI48)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/04/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022		
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	49		
Location:	Mickleham						


Sample No	145	146	147			
Date Tested	22/03/2022	22/03/2022	22/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 8	Layer 8	Layer 8			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.89	t/m ³ 1.94	t/m ³ 1.89			
Field Moisture Content	% 20.4	% 21.0	% 18.3			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, % 3.8	WET, % 4.3	WET, % 4.9			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.87	t/m ³ 2.00	t/m ³ 1.98			
Optimum Moisture Content	% 21	% 21.5	% 20.5			

Moisture Ratio	% 97	% 97.5	% 89			
Moisture Variation	% -0.5	% -0.5	% -2.0			
from OMC	Drier	Drier	Drier			
Density Ratio	% 100.5	% 96.0	% 95.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI49)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)




NATA
WORLD RECOGNISED
ACCREDITATION

NATA Accredited Laboratory No. 20172

Accreditation for compliance with ISO/IEC 17025 - Testing

The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards

Approved Signatory:



David Burns

Date: 20/04/2022

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	50	
Location:	Mickleham					



Sample No	148	149	150			
Date Tested	23/03/2022	23/03/2022	23/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 9	Layer 9	Layer 9			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.89	t/m ³ 1.94	t/m ³ 1.88			
Field Moisture Content	% 20.4	% 19.5	% 22.4			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, % 4.2	WET, % 5.2	WET, % 4.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.95	t/m ³ 1.99	t/m ³ 1.96			
Optimum Moisture Content	% 18.5	% 20.5	% 23			

Moisture Ratio	% 110.5	% 95	% 97.5			
Moisture Variation	% 1.5	% -0.5	% -0.5			
from OMC	Wetter	Drier	Drier			
Density Ratio	% 96.5	% 97.0	% 95.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI50)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/04/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022		
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	51		
Location:	Mickleham						



Sample No	151	152	153			
Date Tested	24/03/2022	24/03/2022	24/03/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 9	Layer 9	Layer 9			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.89	t/m ³ 1.97	t/m ³ 1.94			
Field Moisture Content	% 21.5	% 19.8	% 20.2			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, %	3.2	5.8	5.2		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	1.92	2.06	2.01		
Optimum Moisture Content	%	22	20	21		

Moisture Ratio	%	97.5	99	96		
Moisture Variation	%	-0.5	0.0	-0.5		
from OMC		Drier	OMC	Drier		
Density Ratio	%	98.0	95.5	95.5		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI51)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/04/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

Client:	BMD Urban			Job No:	BMD2022		
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	52		
Location:	Mickleham						


Sample No	154	155	156			
Date Tested	25/03/2022	25/03/2022	25/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	Layer 10	Layer 10	Layer 10			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.87	t/m ³ 1.90	t/m ³ 1.93			
Field Moisture Content	% 20.3	% 20.8	% 19.3			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, % 4.0	WET, % 4.2	WET, % 5.1			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.89	t/m ³ 1.93	t/m ³ 2.00			
Optimum Moisture Content	% 21	% 22	% 19.5			

Moisture Ratio	% 96.5	% 94.5	% 99			
Moisture Variation	% -0.5	% -1.0	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 98.5	% 97.5	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI52)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)




NATA
WORLD RECOGNISED
ACCREDITATION

NATA Accredited Laboratory No. 20172

Accreditation for compliance with ISO/IEC 17025 - Testing

The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards

Approved Signatory:



David Burns

Date: 20/04/2022

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	53	
Location:	Mickleham					



Sample No	157	158	159			
Date Tested	26/03/2022	26/03/2022	26/03/2022			
Time Tested	AM	AM	AM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	FSL	FSL	FSL			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.98	t/m ³ 1.95	t/m ³ 1.99			
Field Moisture Content	% 20.8	% 20.0	% 19.7			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, %	4.1	4.5	4.9		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m ³	2.01	2.03	2.07		
Optimum Moisture Content	%	21	20.5	20.5		

Moisture Ratio	%	99	97.5	96		
Moisture Variation	%	0.0	-0.5	-0.5		
from OMC		OMC	Drier	Drier		
Density Ratio	%	98.0	95.5	96.0		

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI53)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/04/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included	
	in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	54	
Location:	Mickleham					



Sample No	160	161	162			
Date Tested	28/03/2022	28/03/2022	28/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	FSL	FSL	FSL			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.99	t/m ³ 2.00	t/m ³ 1.85			
Field Moisture Content	% 21.3	% 19.0	% 21.3			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, % 5.2	WET, % 5.8	WET, % 3.8			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 2.07	t/m ³ 2.06	t/m ³ 1.91			
Optimum Moisture Content	% 21.5	% 19.5	% 22			

Moisture Ratio	% 99	% 97.5	% 97			
Moisture Variation	% -0.5	% -0.5	% -1.0			
from OMC	Drier	Drier	Drier			
Density Ratio	% 96.0	% 96.5	% 96.0			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI54)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/04/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	

Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd
5/16 Network Drive
Truganina VIC 3029
PH: 0400 413 531
info@ayassociates.com.au

Client:	BMD Urban			Job No:	BMD2022	
Project:	Merrifield Estate - Stage 47 (Level 1)			Report:	55	
Location:	Mickleham					



Sample No	163	164	165			
Date Tested	29/03/2022	29/03/2022	29/03/2022			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	FSL	FSL	FSL			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m ³ 1.95	t/m ³ 1.99	t/m ³ 1.91			
Field Moisture Content	% 20.4	% 18.5	% 9.4			
Material:	Imported Clay	Imported Clay	Imported Clay			

Oversize Material	WET, % 4.3	WET, % 4.0	WET, % 5.1			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m ³ 1.98	t/m ³ 2.07	t/m ³ 1.98			
Optimum Moisture Content	% 21	% 19	% 10			

Moisture Ratio	% 97	% 97.5	% 93.5			
Moisture Variation	% -0.5	% -0.5	% -0.5			
from OMC	Drier	Drier	Drier			
Density Ratio	% 98.0	% 95.5	% 95.5			

Specification:	95% STD	Test Selection:	N/A
Notes:	Ref : 1120 0304-1 (SI55)		
Test Method	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	Sampling Method:	AS 1289 1.2.1 6.4(b)

 NATA WORLD RECOGNISED ACCREDITATION	NATA Accredited Laboratory No. 20172	Approved Signatory:  David Burns Date: 20/04/2022
	Accreditation for compliance with ISO/IEC 17025 - Testing	
	The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards	